



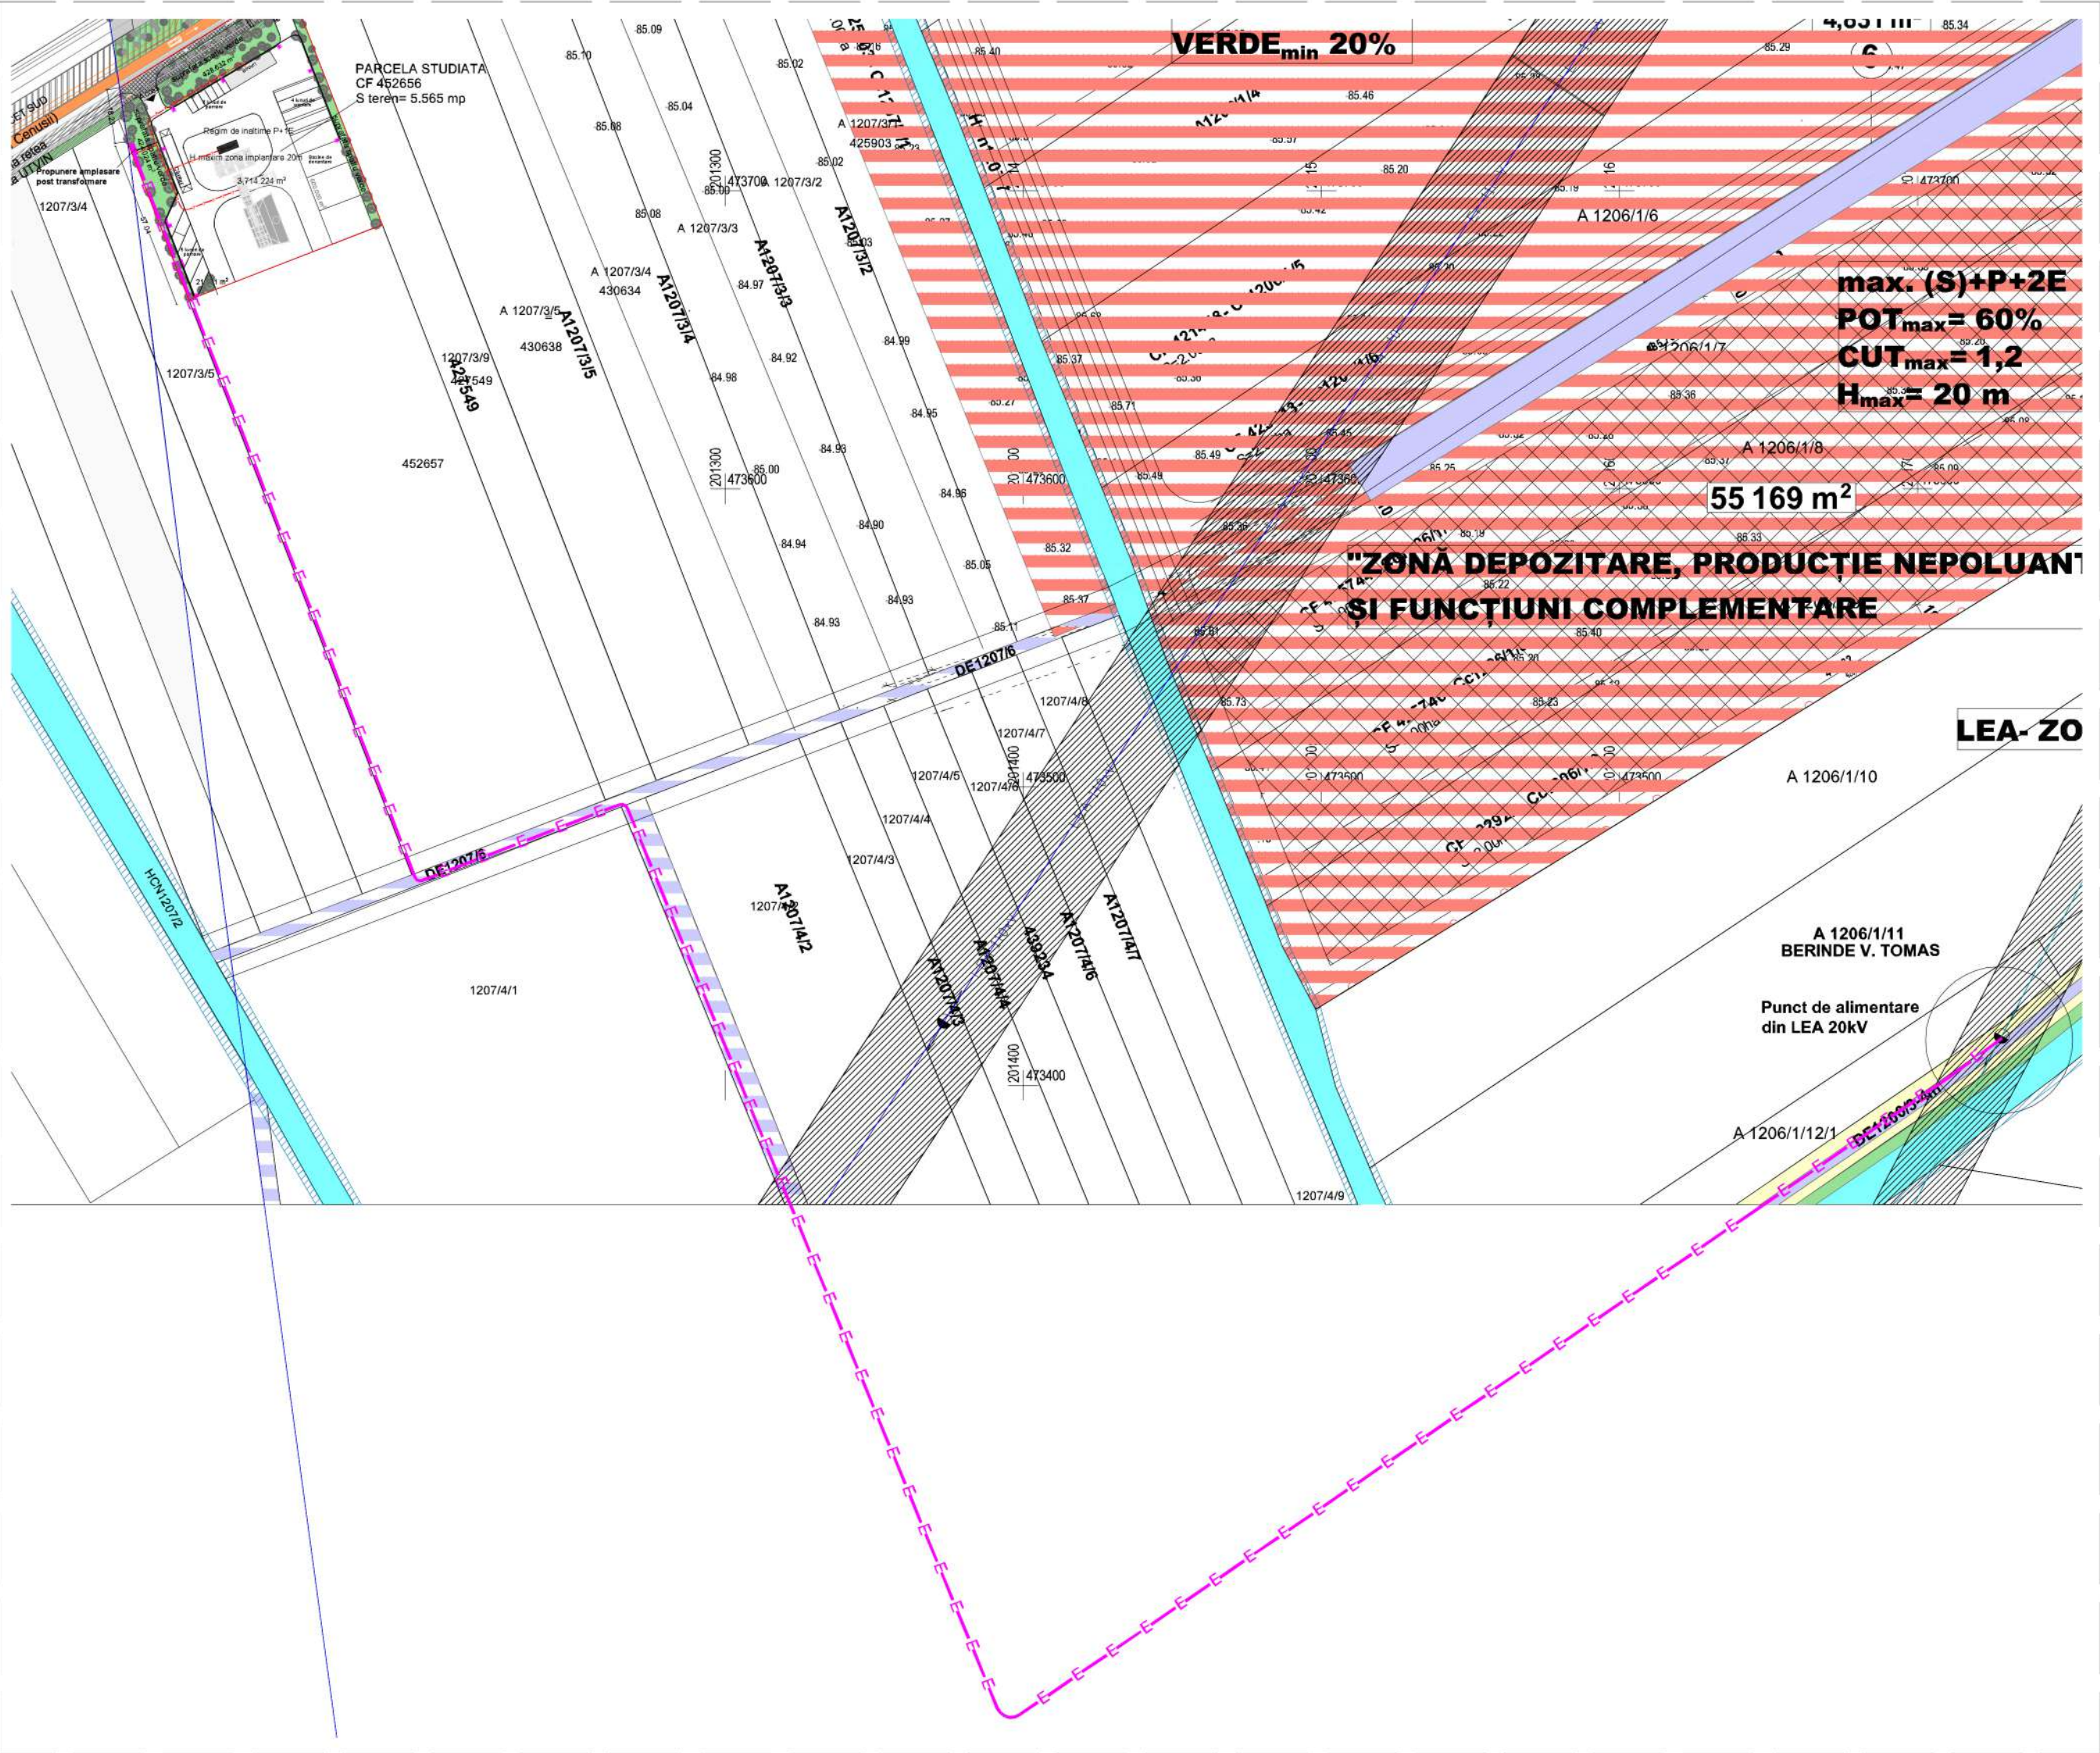

NOTA :
1. Propunerea de amplasare a postului de transformare este informativa, solutia de alimentare a zonei studiate urmand a fi decisa de operatorul de distributie zonal.

- LEGENDA
- — — — — Linie electrica subterana (LES) joasa tensiune 0,4 kV
 - — — — — Linie electrica subterana (LES) medie tensiune 20 kV
 - — — — — Traseu cablu subteran pentru iluminat
 - Stalp de iluminat public, metalic, h=11m, echipat cu un corp de iluminat cu sursa LED 100W
 - Post de transformare, in anvelopa de beton, 20kV/0,4kV, 400 kVA

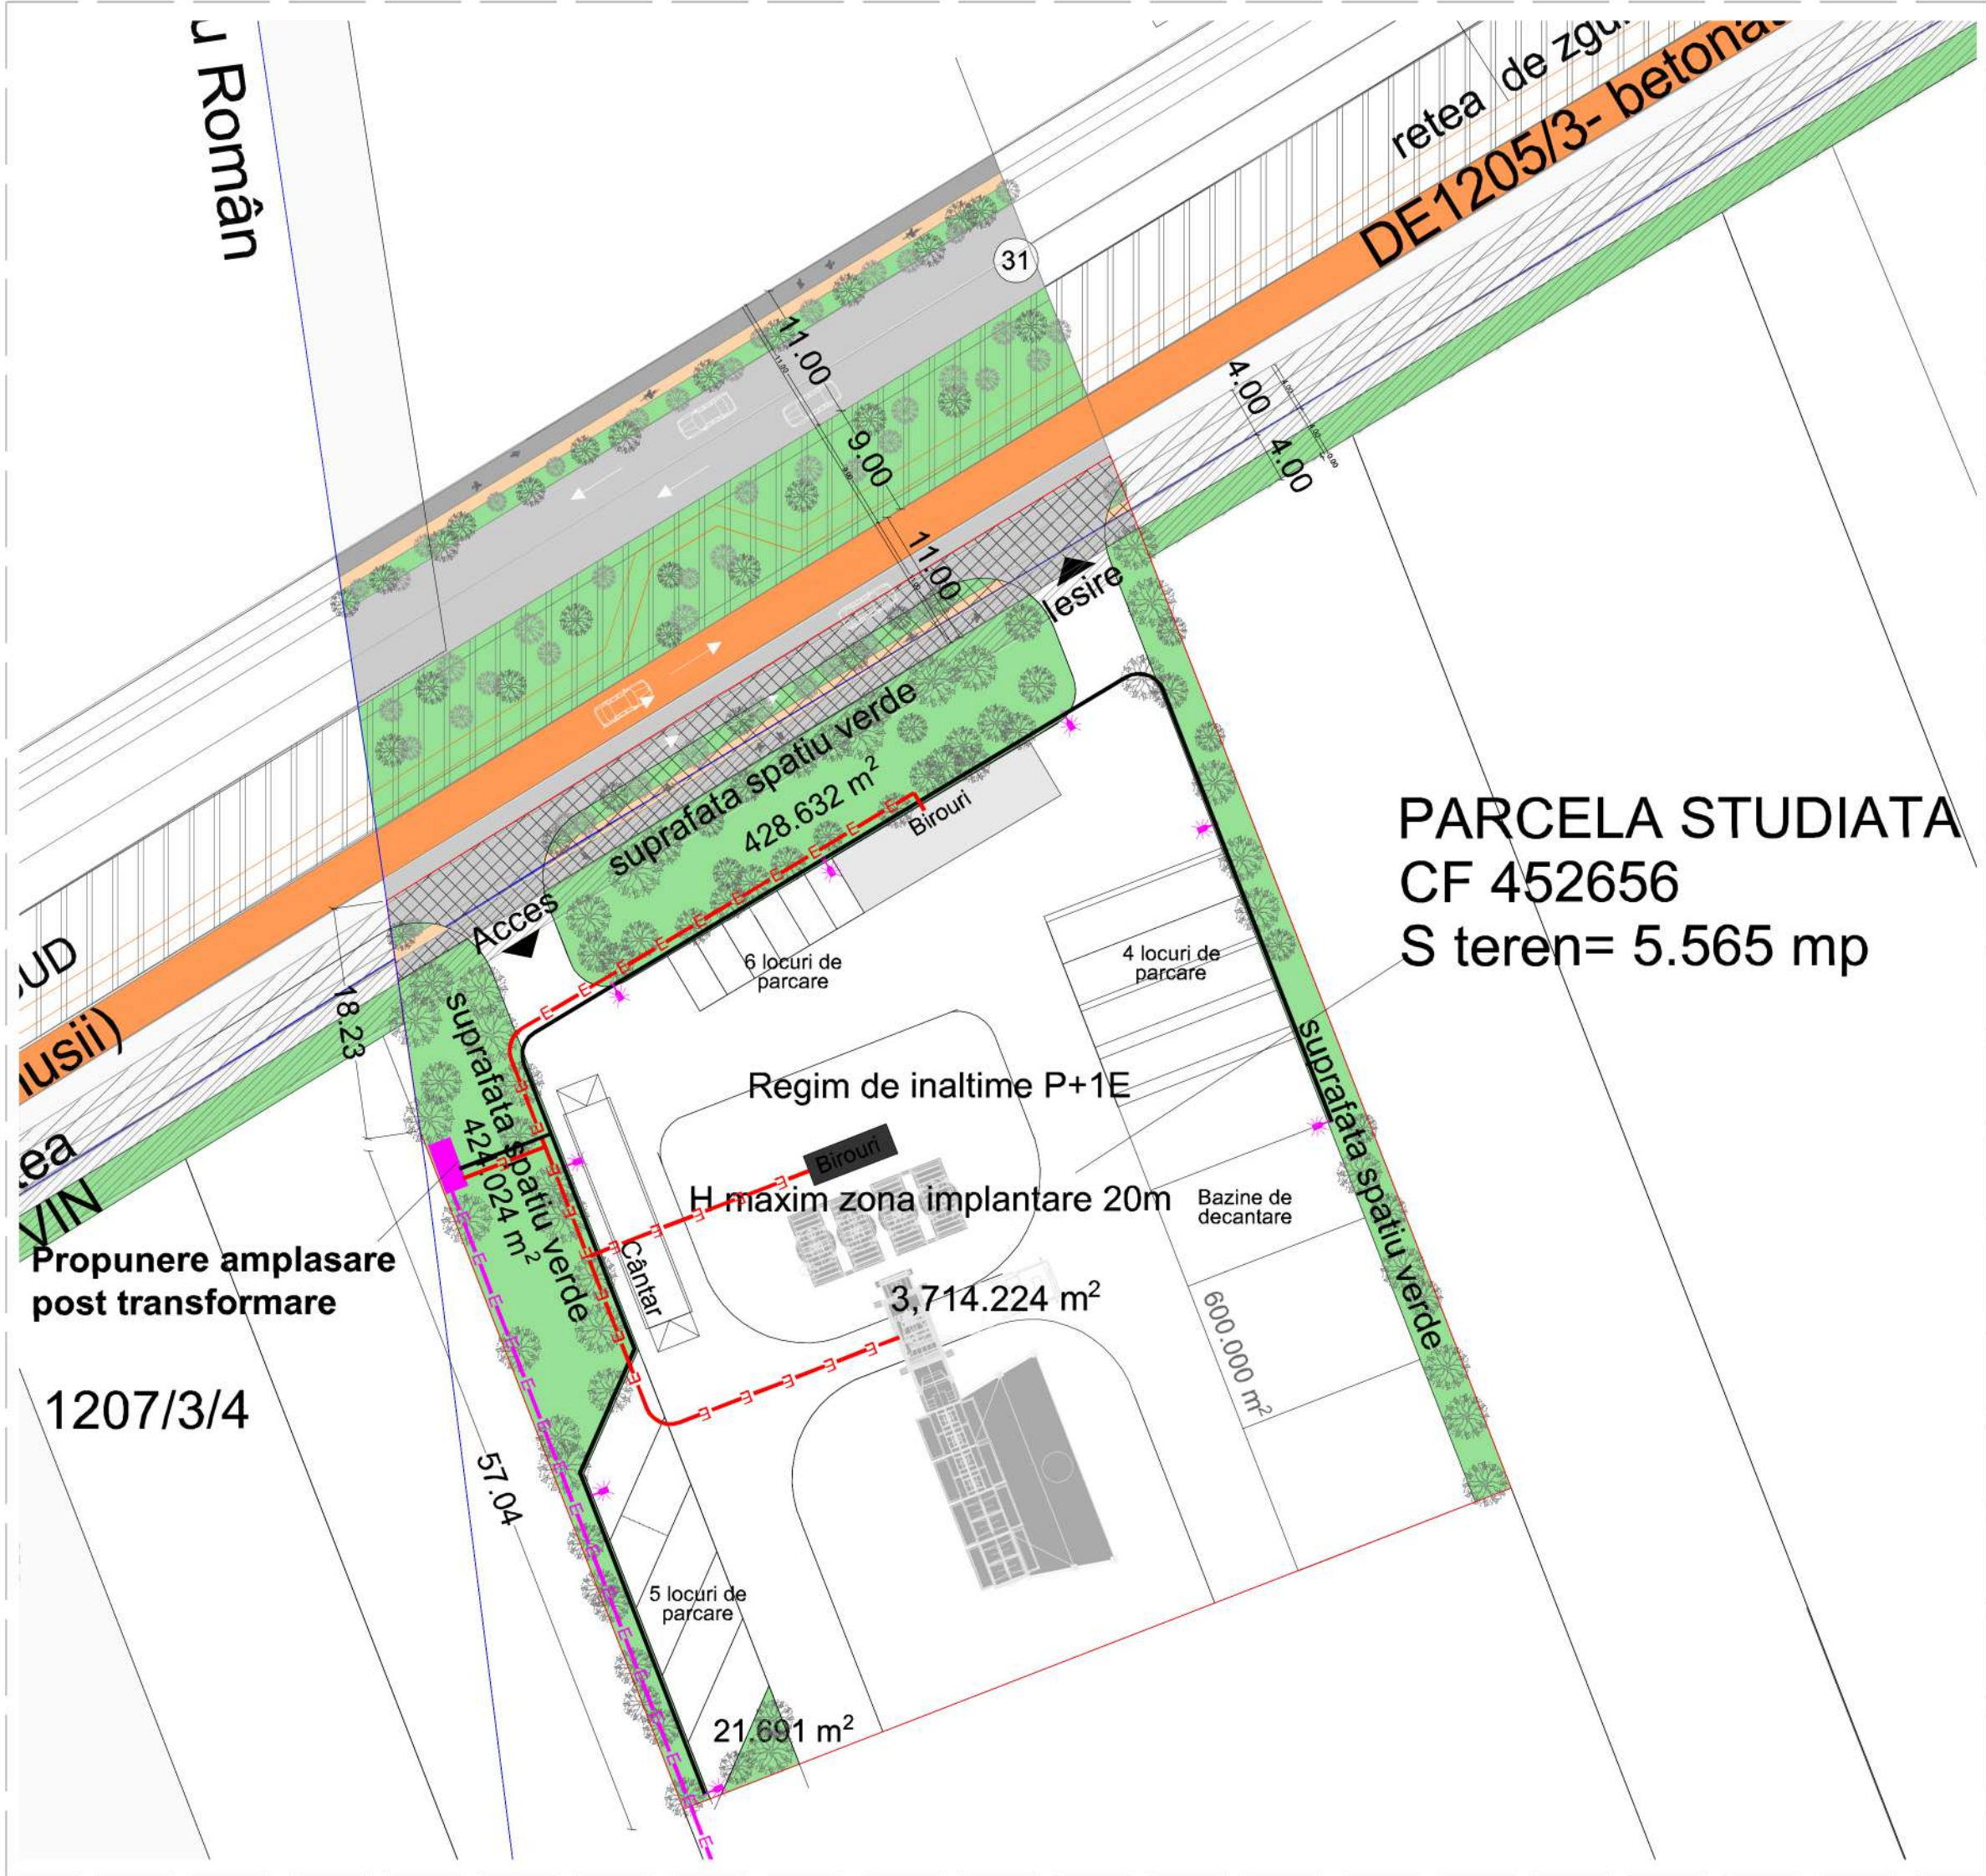

Proiectant general: S.C. ATG STUDIO S.R.L.			
VERIFICATOR / EXPERT	NUME	SEMINATURA	CERINTA
Alina ANRE 16959/2021		69803/A/0001/LK/Rb	
SPECIFICATIE : NUME		SEMINATURA	
300704, Timisoara, str. Magnoliei nr. 45		Scara : 1:500 1:2000	
Sef Proiect : Arh. Marius Canceal		Data : 01. 2022	
Proiectat : Ing. Alin Tudor		Titlu planşa : Reglementari - echipare editlita	
Desenat : Ing. Alin Tudor		- instalati electrice	
Beneficiar :			Nr. proiect : ELDDCT-1005/2022
Amplasament : Str. DE 1205/3 (Drumul cenusii) CF 452656,			Faza : P.U.Z.
INSTALATIE TEHNOLOGICA PENTRU FABRICAREA BETOANELOR, PLATFORMA PADOC MATERIE PRIMA, IMPREJMUIRE			Nr. plansa : U08